
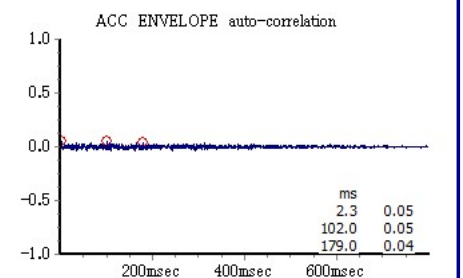
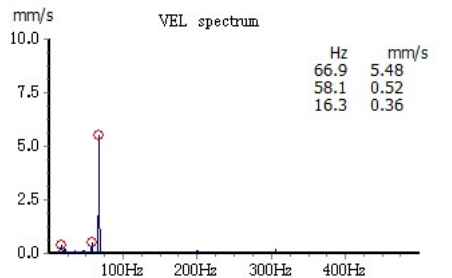
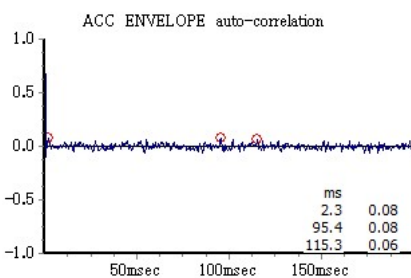
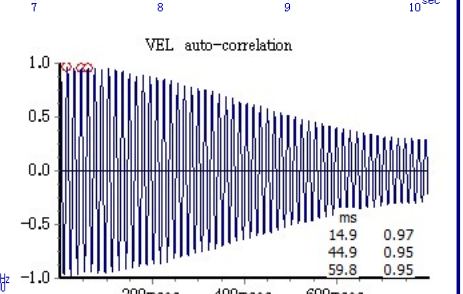
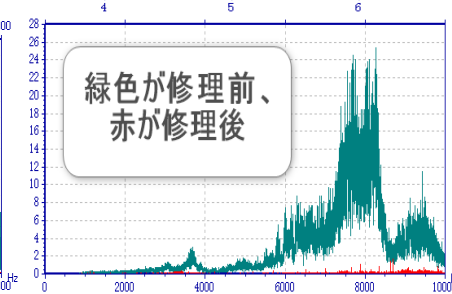
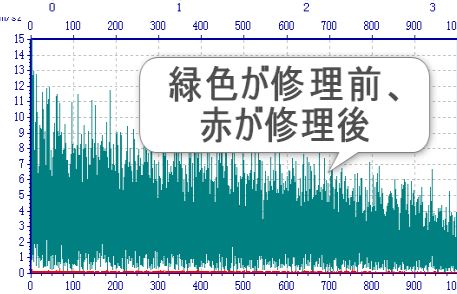
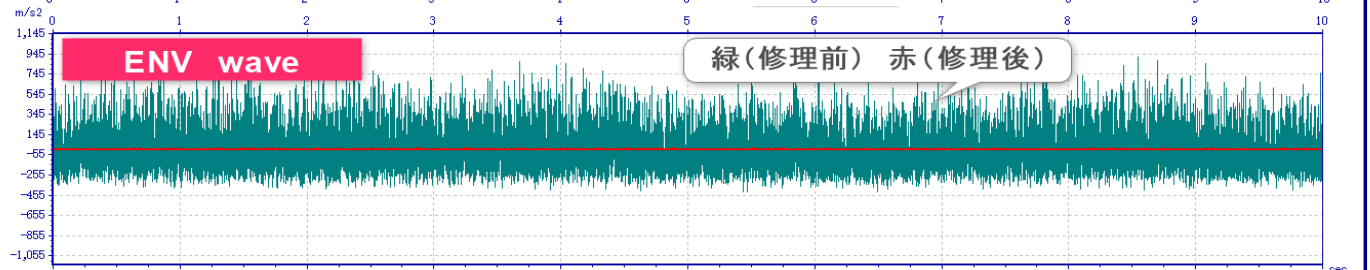
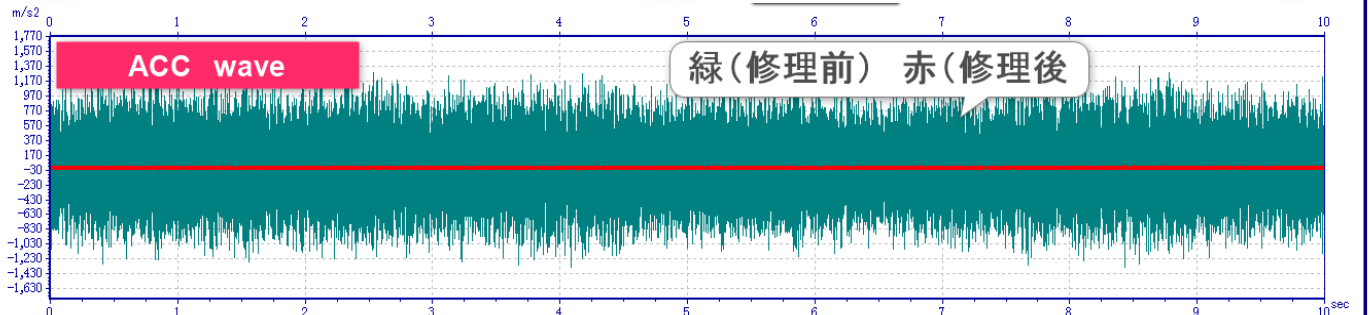
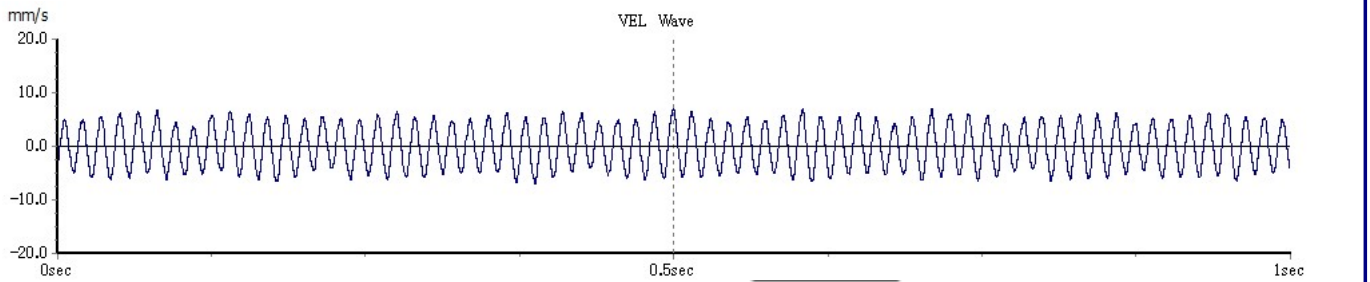


Analysis data
振動診断カルテ

部位/方向 01H 症状/異常原因

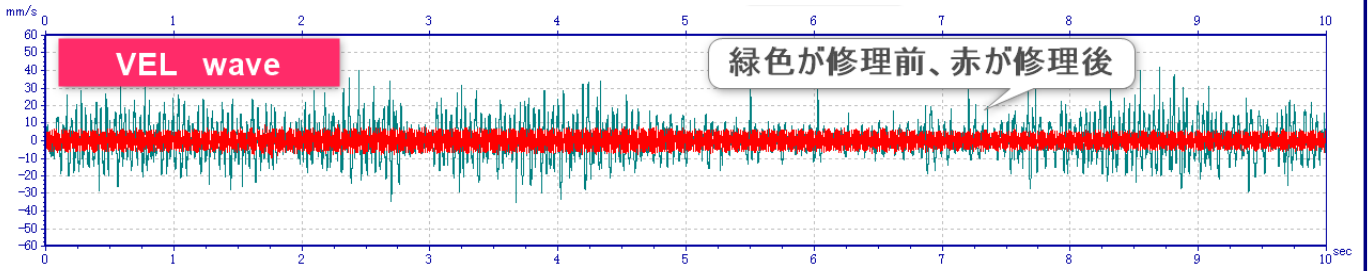

軸受No. 6216ZZ

諸元計算値

回転 :fr	回転 :2fr	内輪 :fi	外輪 :fo	転動体:fb	転動体:2fb	保持器:fc	Z数成分:fp
66.87 Hz	133.73 Hz	428.95 Hz	306.58 Hz	195.40 Hz	390.81 Hz	27.87 Hz	267.47 Hz
14.96 ms	7.48 ms	2.33 ms	3.26 ms	5.12 ms	2.56 ms	35.88 ms	3.74 ms